





REMSI Sketches 1-25
Sketch #25
6-50

0000-000-ST-6050
 Custom ID: DCS 6-50
 Revision: 01
 Effective Date: 09/19/2016
 Page 64 of 69

Sketch #25 Secondary service meter base connections for self-contained meters, overhead service, 100 and 200 ampere

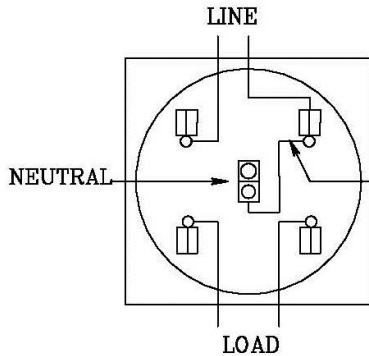


2 WIRE, 1 PHASE, 120 V
 TABLE 1 - APPROVED METER SERVICE DEVICES

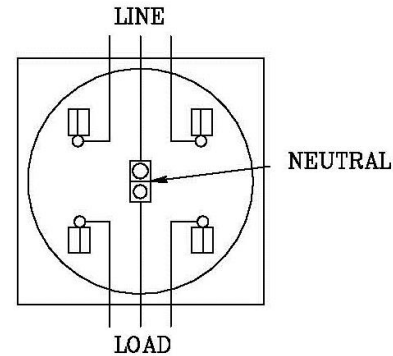


3 WIRE, 1 PHASE, 120/240 V
 TABLE 1 - APPROVED METER SERVICE DEVICES

JUMPER BY CUSTOMER.
 SIZED FOR SERVICE
 AMPACITY #6
 MINIMUM INSULATED
 CONDUCTOR.

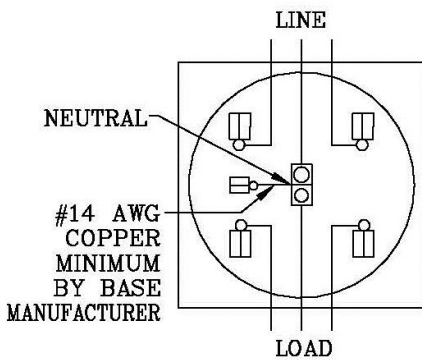


3 WIRE NETWORK, 208/120 V
 TABLE 1 - APPROVED METER SERVICE DEVICES
WITH 5th TERMINAL ACCESSORY

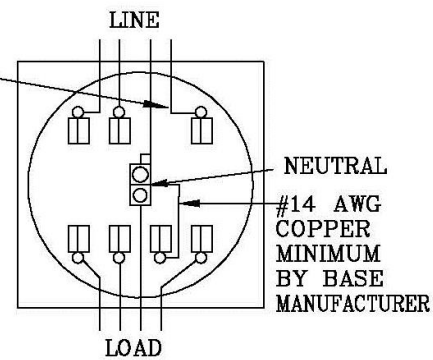

4 WIRE, 3 PHASE, DELTA 240/120 V
 TABLE 3 - APPROVED METER SERVICE DEVICES

THE CONDUCTOR WITH
 HIGHER VOLTAGE TO
 GROUND MUST BE
 INSTALLED IN RIGHT
 HAND POSITION OF
 THE METER BASE
 AND MUST BE
 IDENTIFIED.

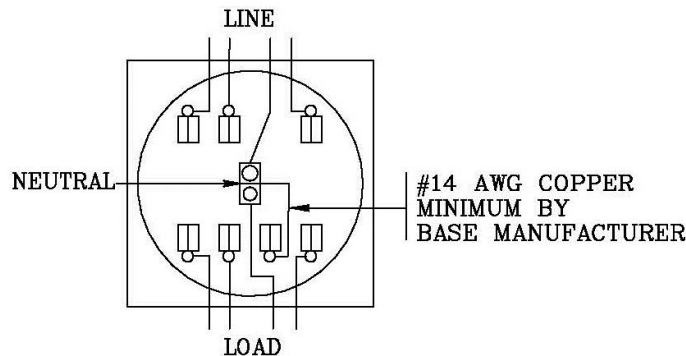

4 WIRE, 3 PHASE, 208Y/120 V
 TABLE 3 - APPROVED METER SERVICE DEVICES

<p>RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS PPL ELECTRIC UTILITIES CORPORATION</p>	<p>Rules: 5, 10, 12, 13, 14, 16, 20 Date: 7/18/16 Engr: NAP</p>
--	---

REMSI_S025_R1.dwg